

TRANSLATION

(1) **Type Examination Certificate**

(2) No. of the Type Examination Certificate: **ZP/B070/20** replaces ZP/B074/15

(3) Product: **Anchor device type A**  
**Type: LUX-top® CORDA**

(4) Manufacturer: **ST-Quadrat s.a.**  
**11, rue Flaxweiler**  
**6776 Grevenmacher/ Potaschberg**  
**LUXEMBURG**

(5) Site of manufacture: **ST QUADRAT Fall Protection S.A.**  
**45, rue Fuert**  
**5410 BEYREN**  
**LUXEMBURG**

(6) The design of this product and any acceptable variation thereto are specified in the schedule to this Type Examination Certificate.

(7) The certification body of DEKRA Testing and Certification GmbH certifies that this product complies with the fundamental requirements of the standard listed under item 8 below. The examination and test results are set out in the report PB 20-097.

(8) The requirements of the standard are assured by compliance with

**DIN EN 795:2012**

**DIN CEN/TS 16415:2017**

(9) This Type Examination Certificate relates only to the design, examination and tests of the specified product in accordance to the standard list. Further requirements of the Directive apply to the manufacturing process and supply of this personal protective equipment. These are not covered by this certificate.

(10) This Type Test Certificate is valid until 2025-07-19.

DEKRA Testing and Certification GmbH  
Bochum, 2020-07-20

signed: Kilisch  
Managing director

We confirm the correctness of the translation from the German original.  
In the case of arbitration only the German wording shall be valid and binding.



Managing director

## TRANSLATION

- (11) Appendix to
- (12) **Type Examination Certificate**  
**ZP/B070/20**
- (13) 13.1 Subject and Type  
Anchor device type A  
Type: LUX-top® CORDA

### 13.2 Description

The anchor device of type LUX-top® CORDA is used to protect three person against falls from a height and is attended for installation on surfaces with sufficient strength (Fig. 1-3). The installation is carried out through two drill holes ( $\varnothing 12\text{mm}$ ) in the base plate ( $t = 4\text{mm}$ ) and two fastening elements according to the mounting surface.

A wire rope ( $\varnothing 6\text{ mm}$ ) is mounted in the centre of the base plate, which is provided with a pressed rope eyelet at both ends. One end is connected to the base plate by a mushroom head bolt. At the other end, the user can fasten the connector of his PPE to protect himself against falls from a height.

The anchor device is intended for bearing loads exerted from any direction parallel to the structure surface, and is made of corrosion-resistant steel.

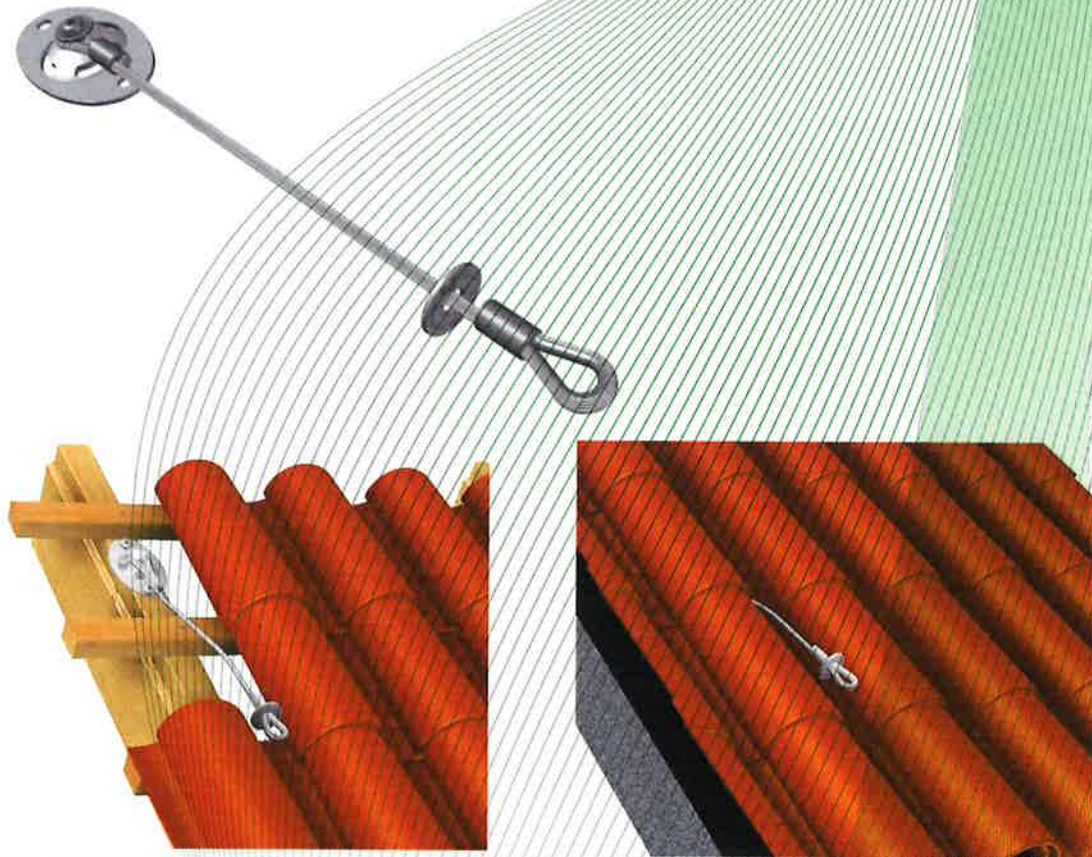


Fig. 1-3: Anchor device, type: LUX-top® CORDA

- (14) Report  
PB 20-097, 2020-07-20